

# DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER) BOARD AND CODE ADMINISTRATION DIVISION

# **NOTICE OF ACCEPTANCE (NOA)**

MIAMI-DADE COUNTY PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208 Miami, Florida 33175-2474 T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

Loren Cook Company 2015 E. Dale Street Springfield, MO 65803

### SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

## **DESCRIPTION:** Model GR Steel and Aluminum Rooftop Gravity Vent

**APPROVAL DOCUMENT:** Drawing No. **SD080717-14**, titled "GR Gravity Ventilator Hurricane Rated Aluminum and Steel", sheets 1 through 6 of 6, dated 09/03/2013, prepared by Loren Cook Company, signed and sealed by Bradley F. Skidmore, P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

## MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 13-0708.09 and consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by Carlos M. Utrera, P.E.

MIAMI-DADE COUNTY
APPROYED

Afteria 01/19/2016

NOA No. 15-1013.04 Expiration Date: November 13, 2018 Approval Date: January 28, 2016 Page 1

#### NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

#### A. DRAWINGS "Submitted under NOA # 13-0708.09"

1. Drawing No. SD080717-14, titled "GR Gravity Ventilator Hurricane Rated Aluminum and Steel", sheets 1 through 6 of 6, dated 09/03/2013, prepared by Loren Cook Company, signed and sealed by Bradley F. Skidmore, P.E.

#### B. TESTS "Submitted under NOA # 08-0908,17"

- 1. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
  - 2) Large Missile Impact Test per FBC, TAS 201-94
  - 3) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with marked-up drawings and installation diagram of Series/Model 36"x 36" GR, Galvanized Steel Roof Vent, prepared by Architectural Testing, Inc., Test Report No. 79144.01-801-18, dated 03/03/2008, signed and sealed by Jeffrey T. Kaminski, P.E.

- 2. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
  - 2) Large Missile Impact Test per FBC, TAS 201-94
  - 3) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with marked-up drawings and installation diagram of Series/Model 36"x 36" GR, Aluminum Roof Vent, prepared by Architectural Testing, Inc., Test Report No. **79144.02-801-18**, dated 06/19/2008, signed and sealed by Jeffrey T. Kaminski, P.E.

#### C. CALCULATIONS "Submitted under NOA # 13-0708,09"

1. Wind load and anchor verification calculations, prepared by Loren Cook Company, dated 09/13/2013, signed and sealed by Bradley F. Skidmore, P.E.

#### "Submitted under NOA # 08-0908.17"

2. Wind load and anchor verification calculations, prepared by Tom Barrow Co., complying with FBC-2004, dated 07/18/2008, signed and sealed by John D. Winslow, P.E.

#### D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

#### E. MATERIAL CERTIFICATIONS

1. None.

#### F. STATEMENTS

1. Statement letter of code conformance to the 5th edition (2014) FBC issued by Loren Cook Company, dated 11/16/2015, signed and sealed by Bradley F. Skidmore, P.E.


#### "Submitted under NOA # 13-0708.09"

- 2. Statement letter of code conformance to 2010 FBC issued by Loren Cook Company, dated 06/27/2013, signed and sealed by Bradley F. Skidmore, P.E.
- 3. Statement letter of no financial interest issued by Loren Cook Company, dated 09/13/2013, signed and sealed by Bradley F. Skidmore, P.E.

Carlos M. Utrera, P.E.

Product Control Examiner NOA No. 15-1013.04

Expiration Date: November 13, 2018 Approval Date: January 28, 2016

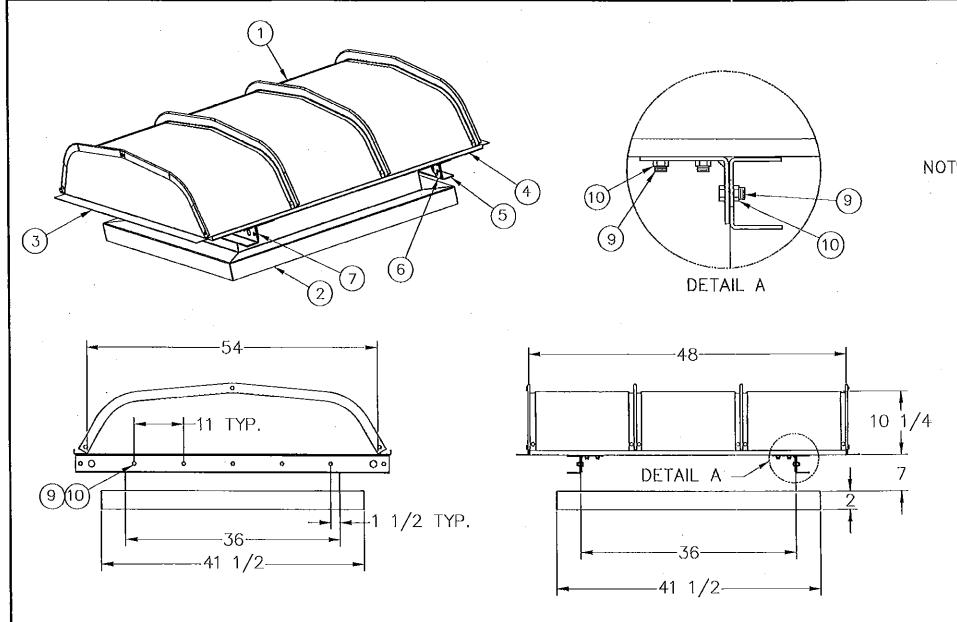

NOTES:

# DESIGN PRESSURE:

+/-130PSF - GALVANIZED STEEL CONTRUCTION

+/- 60PSF - ALUMINUM CONSTRUCTION

IMPACT RATING: LARGE MISSILE IMPACT RESISTANT

ALL DIMENSIONS IN INCHES

UNIT SIZE DETERMINED BY INSIDE THROAT DIMENSION


SIZE 36X36 SHOWN

UNIT SIZE NOT TO EXCEED 36X36

UNIT SIZES SMALLER THAN 36X36 ARE ACCEPTABLE

MINIMUM UNIT SIZE IS 12X12

11	AR	_	1/2 x 1/2 GALV. ST.	BIRDSCREEN MESH,038 WIRE
10	20		5/16-18 STEEL	FLANGE NUT-ZINC COATED
9	20	_	5/16-18 X 3/4 ST,	HWH BOLT-ZINC COATED
8	24	-	1/4 X 3/4 STEEL	HWH SELF-DRILL SCREW
7	2	SHEET6	_	GI/GR MOUNTING BRACKET LEFT
6	2	SHEET6	-	GI/GR MOUNTING BRACKET RIGHT
5	2	SHEET4		MOUNTING CHANNEL
4	2	SHEET4	_	SECTION RAIL
3	2	SHEET4	-	HOOD END PANEL
2	1	SHEET5		BASE WELDMENT
1	4 -	SHEET3	_	HOOD PANEL
ITEM	QTY	DWG NO.	MATERIAL SPEC.	DESCRIPTION .




PRODUCT REVISED
as complying with the Florida
Building Code Acceptance No 15-1013, Expiration Date 11113 20 MAT'L Loren Cook Co. DRAWN JMD 09/03/13


as complying with the Florida Building Code Acceptance No./2-0708.0 Explination/Date III 3 2018	PR	opud	er e	EVISI	3D	
Building Code Acceptance No.13-0708.0	88	comply	ying v	witht	ho Flo	rida
Acceptance No. 3-0798,0 Expiration/Date 11/13/2018	Bu	lldita	Code			
Expiration page [1] 3 [2018	AO	<b>April</b> an	ec N	°/2;	0.10	<i>0.0</i>
	EDG	HITTO	iy pai	e ///	2/2	018
By ( Phrone	Μĺ		ade P	mduc	Cons	Tol


REV.

RAWN	JMD	09/03/13	1700	MANUFACTURERS OF AIR MOVING EX	JIPMENT			
SIGNER	BFS	SHEET 1 OF 6	1.10	SPRINGFIELD, MISSOURI				
DO NOT SCALE DRAWING			CR C	RAVITY VENTILATO	<del>R</del>			
TOLERANCES	UNLES	unless otherwise noteo		1				
DECIMAL	1	FRACTIONAL.		HURRICANE RATED				
"XX⇔±.063, "010.±⇒XX		≤12"=±1/16" >12" THRU 96"=±1/8" >96" THRU 144"=±1/4" >144"=±3/8"		ALUMINUM AND STEEL				
"100.±-XX				DRAWING NO.	REV.			
ANGULAR	٦			SD080717-14	R			
±2'	(NC	)=NO INSPECTION REQ'D	B	30000717114	ט			

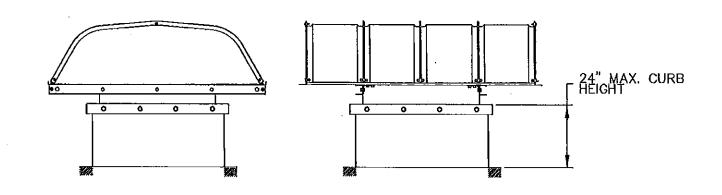

#### ATTACHMENT OF CURB TO ROOF STRUCTURE

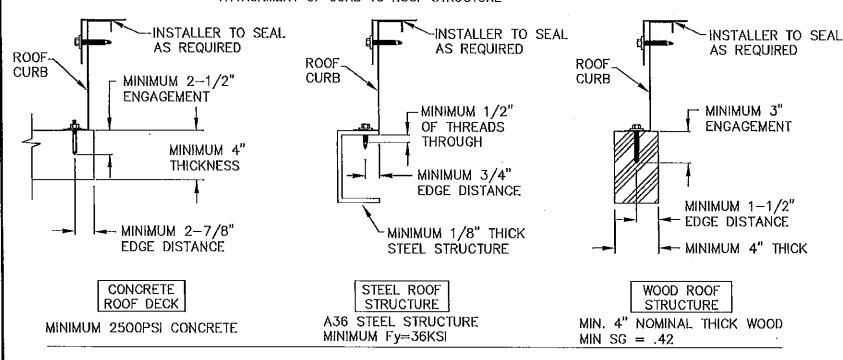

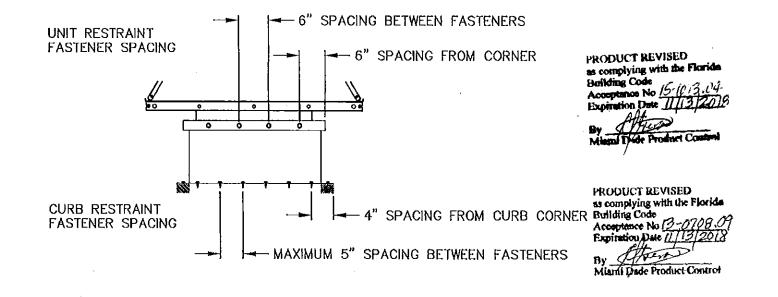

#### NOTES:

- 1) GR GRAVITY VENTILATOR AS REFERRED TO HEREIN REFERS TO ALL LOREN COOK MODEL GR GRAVITY VENTILATORS IN SIZES DEFINED BY THE INSIDE THROAT DIMENSIONS UP TO SIZE 36 X 36. THE EXTERIOR HOUSING AND COMPONENTS MAY BE CONSTRUCTED OF EITHER GALVANIZED STEEL OR ALUMINUM WITH THE PRESSURE RATINGS DEFINED ON SHEET #1.
- 2) THIS APPROVAL IS FOR THE STRUCTURAL CAPACITY OF THE EXTERIOR HOUSING ONLY, IT DOES NOT INCLUDE ANY INTERIOR MECHANISM OR ELECTRICAL PART.
- 3) THIS PRODUCT HAS NOT BEEN TESTED FOR WATER PENETRATION ACCORDING TO FLORIDA BUILDING CODE, TAS 100(A), WIND DRIVEN RAIN TEST, IT CANNOT BE INSTALLED WITHIN THE RIDGE AREA (FBC 1523.6.5.2.13)
- 4) UNIT IS TO INCLUDE A CURB CAP BASE TO FACILITATE MOUNTING OF THE UNIT TO A CURB. THE CURB WILL BE ADEQUATELY ATTACHED TO THE BUILDING STRUCTURE TO SUSTAIN ALL FORCES WHICH MAY BE PRODUCED BY THE PRESCRIBED ENVIRONMENTAL FORCES EXERTED ON THE FAN AND CURB. THE CURB MUST BE ATTACHED TO A STRUCTURAL MEMBER OF THE BUILDING.

CONCRETE DECK: CURB IS TO BE ATTACHED WITH WEDGE TYPE CONCRETE ANCHOR -- MINIMUM 3/8" DIAMETER CARBON STEEL - HILTI KWIK BOLT 3 OR EQUAL. MINIMUM 2-1/2" OF ENGAGEMENT IN 2000 PSI MINIMUM CONCRETE.
MINIMUM DECK THICKNESS IS 4". ANCHORS ARE TO BE INSTALLED 4" FROM EACH CORNER AND SPACED 5" THEREAFTER.

STEEL ROOF STRUCTURE: CURB IS TO BE ATTACHED WITH SELF-DRILLING STEEL SCREWS OF MINIMUM NOMINAL SIZE OF 1/4" DIAMETER AND SCREWS SHALL PASS THROUGH STEEL AT LEAST 1/2". THE SCREWS SHALL BE INSTALLED 4" FROM EACH CORNER AND 5" THEREAFTER.

WOOD ROOF STRUCTURE: CURB IS TO BE ATTACHED WITH STEEL LAG BOLTS NOMINAL SIZE OF 3/8" DIAMETER. WOOD IS TO BE 4" NOMINAL SIZE OR GREATER. THE BOLTS SHALL HAVE A MINIMUM OF 3" OF THREAD ENGAGEMENT. BOLTS SHALL BE INSTALLED 4" FROM EACH CORNER AND 5" THEREAFTER,

- 5) THE CURB SHALL BE CONSTRUCTED OF 3003H-14 ALUMINUM OR G-90 GALVANIZED STEEL OR STAINLESS STEEL. THE CURB MATERIAL THICKNESS SHALL BE 18 GA (,0470") OR GREATER. THE CURB HEIGHT SHALL NOT EXCEED 24".
- 6) THE GR GRAVITY VENTILATOR SHALL BE ATTACHED TO THE CURB WITH ONE OF THE FOLLOWING METHODS INSTALLED ON ALL FOUR SIDES OF THE CURB CAP. THE FASTENERS SHALL BE 6" FROM EACH CORNER OF THE FAN BASE AND SPACED NO GREATER THAN 6" THEREAFTER.
  - #12 X 2" HEX WASHER HEAD SELF-DRILLING SCREW

MAT'L

DRAWN


DESIGNER

- ÄLTERNATE FASTENER .25" HEX HEAD BOLT AND WASHER WITH COMPANION NUT INSTALLED ON THE INTERIOR OF THE CURB.
- 7) ALL FASTENERS ARE TO BE HIGH QUALITY CORROSION RESISTANT STEEL OR STAINLESS STEEL
- 8) ANY GAP BETWEEN THE CURB AND CURB CAP SHALL BE FILLED BY THE INSTALLING CONTRACTOR WITH A SUITABLE CORROSION RESISTANT MATERIAL THAT ALLOWS THE FASTENERS TO BE INSTALLED WITHOUT CAUSING EXCESSIVE DISTORTION OF THE UNIT FLANGES.
- 9) THE INSTALLER IS RESPONSIBLE FOR CHECKING THAT ALL FASTENERS ARE PROPERLY INSTALLED AND ALL ACCESS PANELS ARE IN PLACE BEFORE PUTTING THE UNIT INTO SERVICE.
- 10) ALL FASTENERS AND ACCESS PANELS MUST BE PROPERLY INSTALLED AFTER MAINTENANCE OPERATIONS

DO NOT SCALE DRAWING

09/03/13

SHEET 2 OF



TOLERANCES UNLESS OTHERWISE NOTED DECIMAL FRACTIONAL ≤12"=±1/16" .XX=±.063\* "010.±-XXX. >12" THRU 96"=±1/8" >96" THRU 144"=±1/4" .XXXX¤±.001\* >144"=±3/8" ANGULAR ±2" (NC)=NO INSPECTION REQ'D


**JMD** 


BFS

GR GRAVITY VENTILATOR HURRICANE RATED ALUMINUM AND STEEL DRAWING NO. REV. SD080717-14

LOREN COOK CO.

MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI

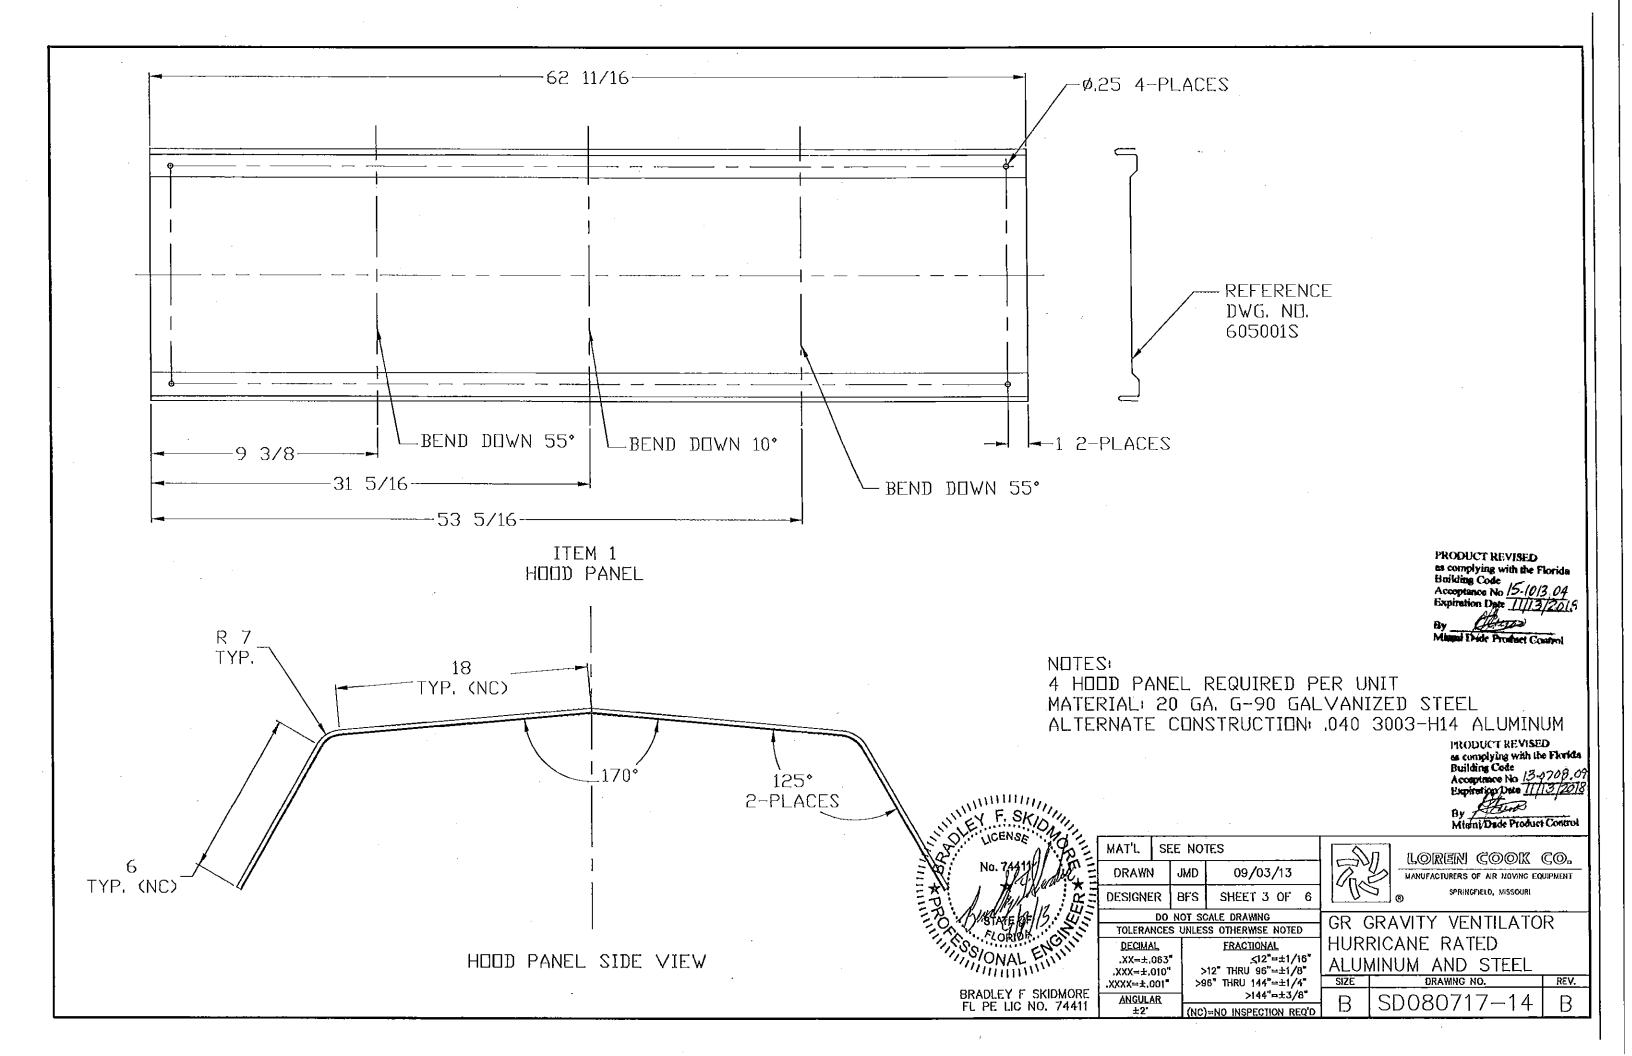

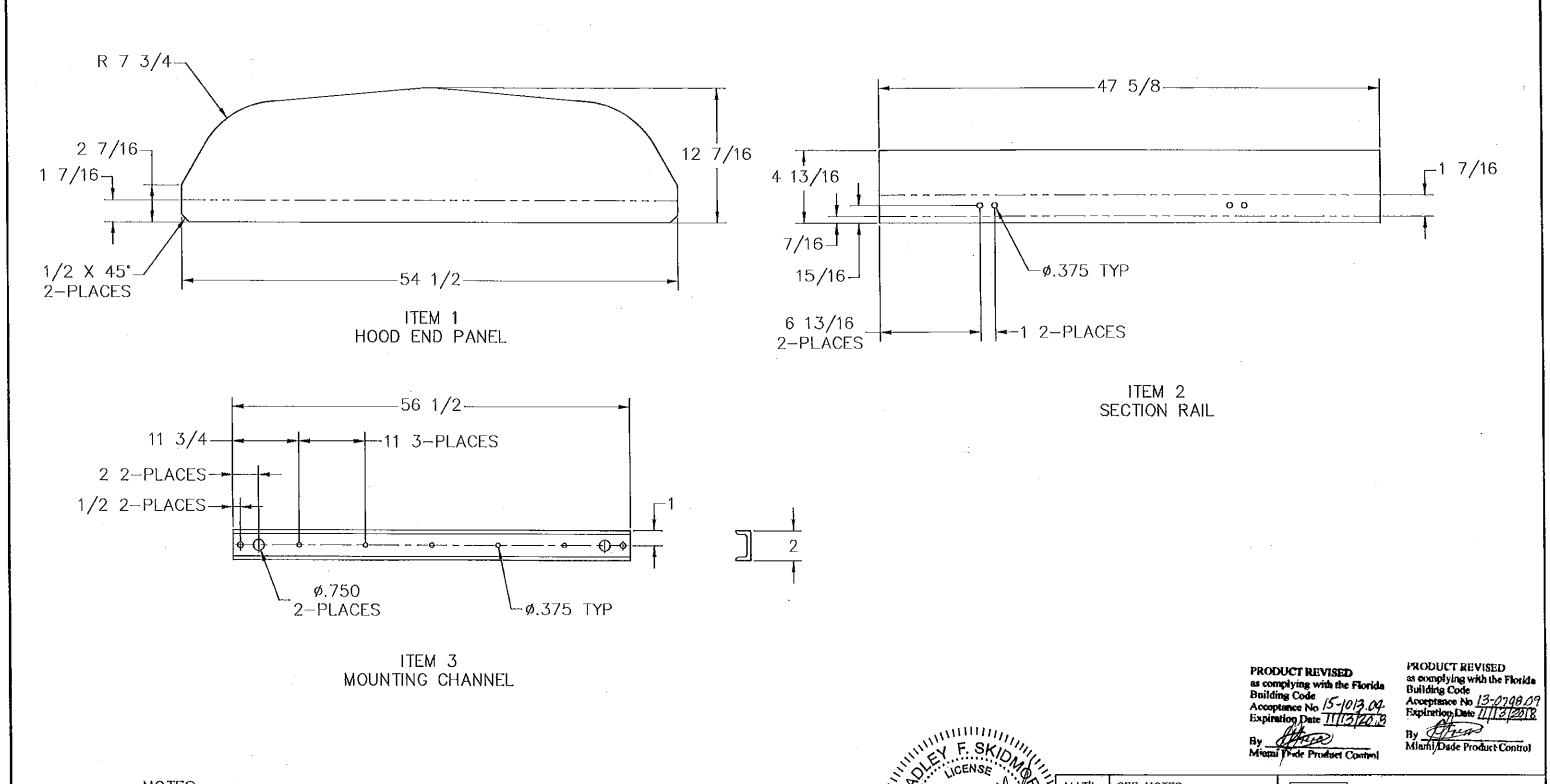


# NOTES:

- 2 HOOD END PANELS REQUIRED PER UNIT 18 GA. GALV STEEL /. 063 ALUM
- 2 SECTION RAILS REQUIRED PER UNIT 16 GA. GALV STEEL/.100 ALUM
- 2 MOUNTING CHANNELS REQUIRED PER UNIT 12 GA. GALV STEEL/2 X .130 ALUM

MATERIAL: G-90 GALVANIZED STEEL

ALTERNATE MATERIAL: 3003 H-14 ALUMINUM



SEE NOTES JMD 09/03/13 BFS SHEET 4 OF DESIGNER DO NOT SCALE DRAWING

TOLERANCES UNLESS OTHERWISE NOTED DECIMAL FRACTIONAL ≤12"=±1/16" >12" THRU 96"=±1/8" .XX⇔±.063" .XXX=±.010" >96" THRU 144"=±1/4" .XXXX=±.001 >144"=±3/8" ANGULAR


(NC)=NO INSPECTION REQ"

LOREN COOK CO. MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI


GR GRAVITY VENTILATOR HURRICANE RATED ALUMINUM AND STEEL REV.

DRAWING NO. SD080717-14

FL PE LIC NO. 74411

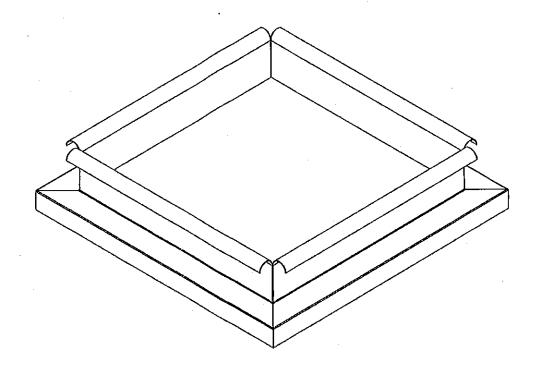

BASE WELDMENT

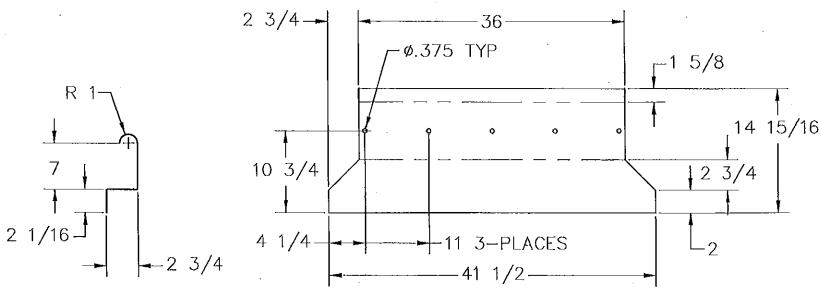

ITEM 1 BASE WIDTH SIDE PANEL 8PUNCH HOLES IN TWO PARTS ONLY

NOTES:

MATERIAL: 16 GA. G-90 GALVANIZE STEEL ALTERNATE MATERIAL: .080 3003 H-14 ALUMINUM



BRADLEY F SKIDMORE FL PE LIC NO. 74411

PRODUCT REVISED as complying with the Florida Building Code Acceptance No 15-1013.04

of Product Control

PRODUCT REVISED as complying with the Florida Building Code
Acceptance No /3-0708.09
Expiration Date 11/13/2018 Mianti Dade Product Control

MAT'L	SE	E NO	TES
DRAWN	1	JMD	09/03/13
DESIGNE	:R	BFS	SHEET 5 OF 6

DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE NOTED FRACTIONAL

\$\leq \leq 12\frac{1}{\tau} \pm \delta 1/16\frac{1}{\tau} \rightarrow 12\frac{1}{\tau} \rightarrow 18\frac{1}{\tau} \rig DECIMAL "£30,±¤XX,

"010.±=XXX, \*100,±=XXXX. >144"=±3/8" ANGULAR ±2' (NC)=NO INSPECTION REQ'D



Loren Cook Co. MANUFACTURERS OF AIR MOVING EQUIPMENT

SPRINGFIELD, MISSOURI

GR GRAVITY VENTILATOR HURRICANE RATED ALUMINUM AND STEEL

DRAWING NO. REV. SD080717-14 В

